


VFD DRIVE INFORMATION WHEN THERE IS A UNDERGROUND CONNECTION

BYPASS LOOP AROUND THE V.F.D. DRIVE

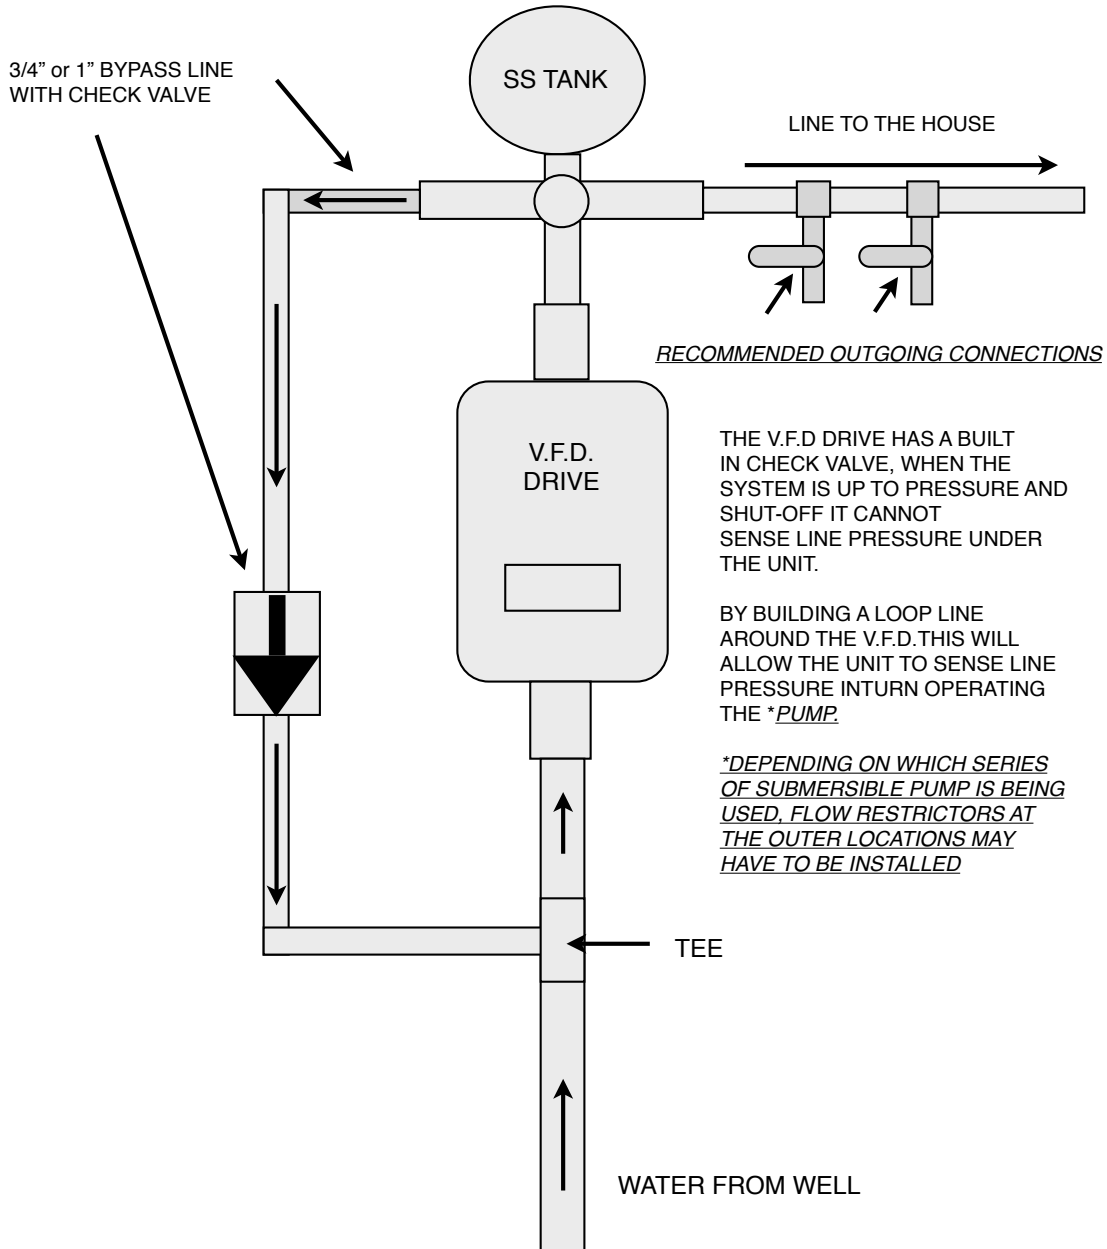

**THIS IS ONLY DONE WHEN UNDERGROUND LINES ARE CONNECTED TO THE SUPPLY LINE*

WE HIGLY RECOMMEND THAT ALL OUTGOING WATER SUPPLY LINES TO CATTLE WATERS, BUILDINGS AND UNDERGROUND SPRINKLERS BE ATTACHED ABOVE THE V.F.D.